




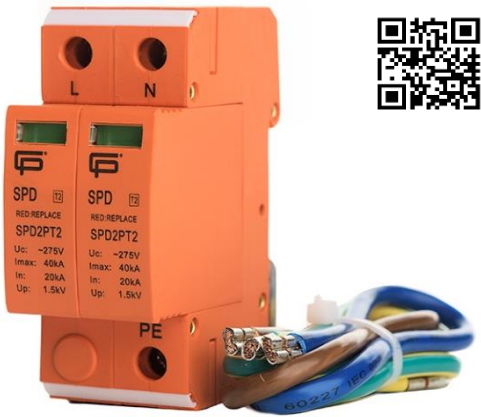
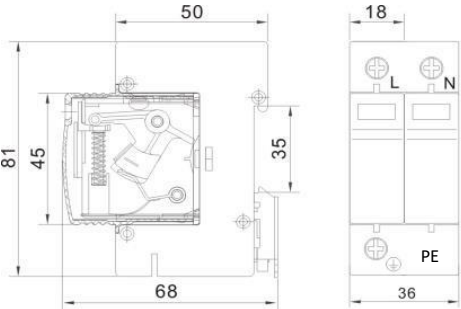
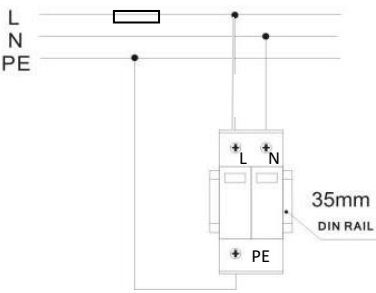

	<b>BARCODE</b>  5 060523 523122 <div>    </div> <div>  </div>
<b>SURGE PROTECTION DEVICE (SPD)</b> <b>SPD2PT2</b>	
<b>PRODUCT IMAGE</b>	<b>DIMENSIONS</b>
 <div> <p><b>CAUTION:</b>  WHEN CONDUCTING INSULATION RESISTANCE TESTING WITH SPD FITTED IT IS RECOMMENDED EITHER THE <b>EARTH CONNECTION OR THE PLUG IN CARTRIDGES ARE REMOVED.</b>  IF YOU DO NOT WISH TO REMOVE THE CARTRIDGES OR EARTH CONNECTION, THEN TESTING MUST BE AT A <b>MAXIMUM OF 250V DC.</b></p> </div>	 <b>CONNECTION DIAGRAM</b> 
<b>PRODUCT DATA</b>	
<b>PART NUMBER</b> <b>BARCODE</b> <b>DESCRIPTION</b> <b>STANDARD</b> <b>FLAG INDICATION</b> <b>TECHNOLOGY</b> <b>VOLTAGE (Un)</b> <b>SYSTEM</b> <b>TERMINAL CAPACITY</b> <b>RECOMMENDED TORQUE</b> <b>DEGREE OF PROTECTION</b> <b>MOUNTING</b> <b>MAXIMUM OPERATING VOLTAGE (Uc)</b> <b>NOMINAL DISCHARGE CURRENT (In 8/20µs)</b> <b>MAXIMUM DISCHARGE CURRENT (Imax 8/20µs)</b> <b>VOLTAGE PROTECTION LEVEL</b> <b>RESPONSE TIME</b> <b>BACK UP FUSE</b> <b>INNER CARTON QTY</b> <b>ORIGIN OF MANUFACTURE</b>	<b>SPD2PT2</b> 5060523523122 SURGE PROTECTION DEVICE T2 EN 61643-11 (Type 2) / IEC 61643-1 (Class II) GREEN: GOOD    RED: REPLACE MOV (METAL OXIDE VARISTOR) 230V~ TN-C-S, TN-S, TT 6mm <sup>2</sup> - 16mm <sup>2</sup> 2.5Nm IP20 35mm DIN RAIL 275V 20kA 40kA ≤1.5kV ≤25ns 125A fuse gG 1 (supplied complete with L, N & E cables 6mm <sup>2</sup> ) CHINA
	Moorfield Industrial Estate, Kilmarnock, KA2 0BA 01563 533554   sales@cpelectric.co.uk   www.cpelectric.co.uk <i>FuseBox is the trading name of CP (Electric) Limited SC553729</i>